


NOT FOR CONSTRUCTION

COMPACTED 2"-MINUS LEVELING PAD OR OTHER OPTION AS SHOWN IN THE INSTALLATION GUIDE**

SCALE: NONE

NO GROUNDWATER CONDITIONS ASSUMED.

**NOTE: SEE INSTALLATION GUIDE FOR VEGETATION OPTIONS AND INSTALLATION GUIDE FOR DETAILS AND OPTIONS.

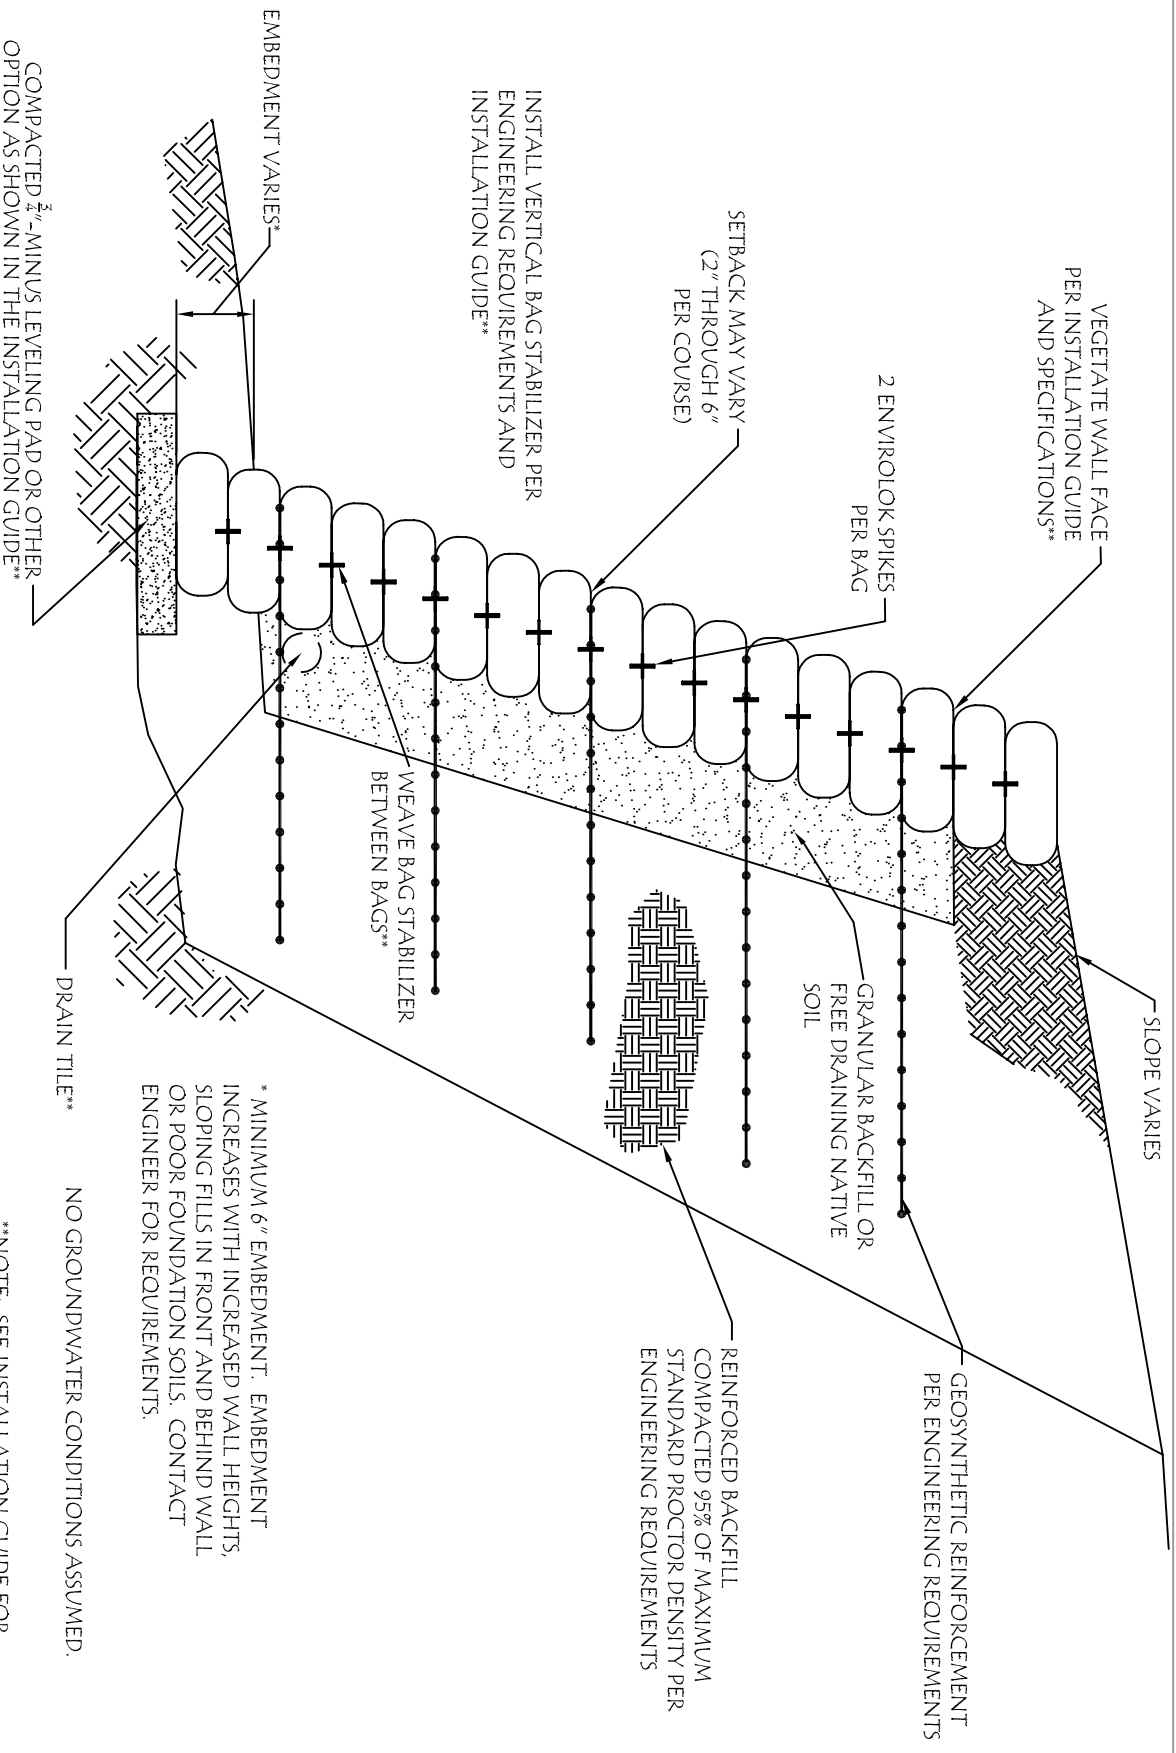

INSTALL VERTICAL BAG STABILIZER PER ENGINEERING REQUIREMENTS AND INSTALLATION GUIDE**

WEAVE BAG STABILIZER BETWEEN BAGS**

EMBEDMENT VARIES*

DRAIN TILE**

* MINIMUM 6" EMBEDMENT. EMBEDMENT INCREASES WITH INCREASED WALL HEIGHTS, SLOPING FILLS IN FRONT AND BEHIND WALL OR POOR FOUNDATION SOILS. CONTACT ENGINEER FOR REQUIREMENTS.

REINFORCED BACKFILL
COMPACTED 95% OF MAXIMUM STANDARD PROCTOR DENSITY PER ENGINEERING REQUIREMENTS

GEOSYNTHETIC REINFORCEMENT PER ENGINEERING REQUIREMENTS

GRANULAR BACKFILL OR FREE DRAINING NATIVE SOIL

THESE DETAILS ARE INTENDED FOR PRELIMINARY DESIGN PURPOSES ONLY. FINAL DETERMINATION OF THE SUITABILITY OF ANY INFORMATION OR MATERIAL IS THE SOLE RESPONSIBILITY OF THE USER. A FINAL PROJECT SPECIFIC DESIGN SHOULD BE PREPARED BY A QUALIFIED, LICENSED, PROFESSIONAL ENGINEER.



2918 AGRICULTURE DRIVE
MADISON, WI 53718
PHONE: 608-226-2544

ENVIROLOK

REINFORCED WALL SECTION

SCALE	AS NOTED
DRAWN BY	PDS
CHECKED BY	PDS
DATE	DECEMBER, 2006
DWG. NO.	REINFORCED SECTION